


FILE: V:\000 - IEIG\109_Design & Const. Standards\Controls\Revision Notes 2 7 2020 RS Home\807-PXCM02F rev2.dwg PLOT DATE: May 1, 2017, 3:01 PM ORIGINAL PAPER SIZE: 11" x 17"

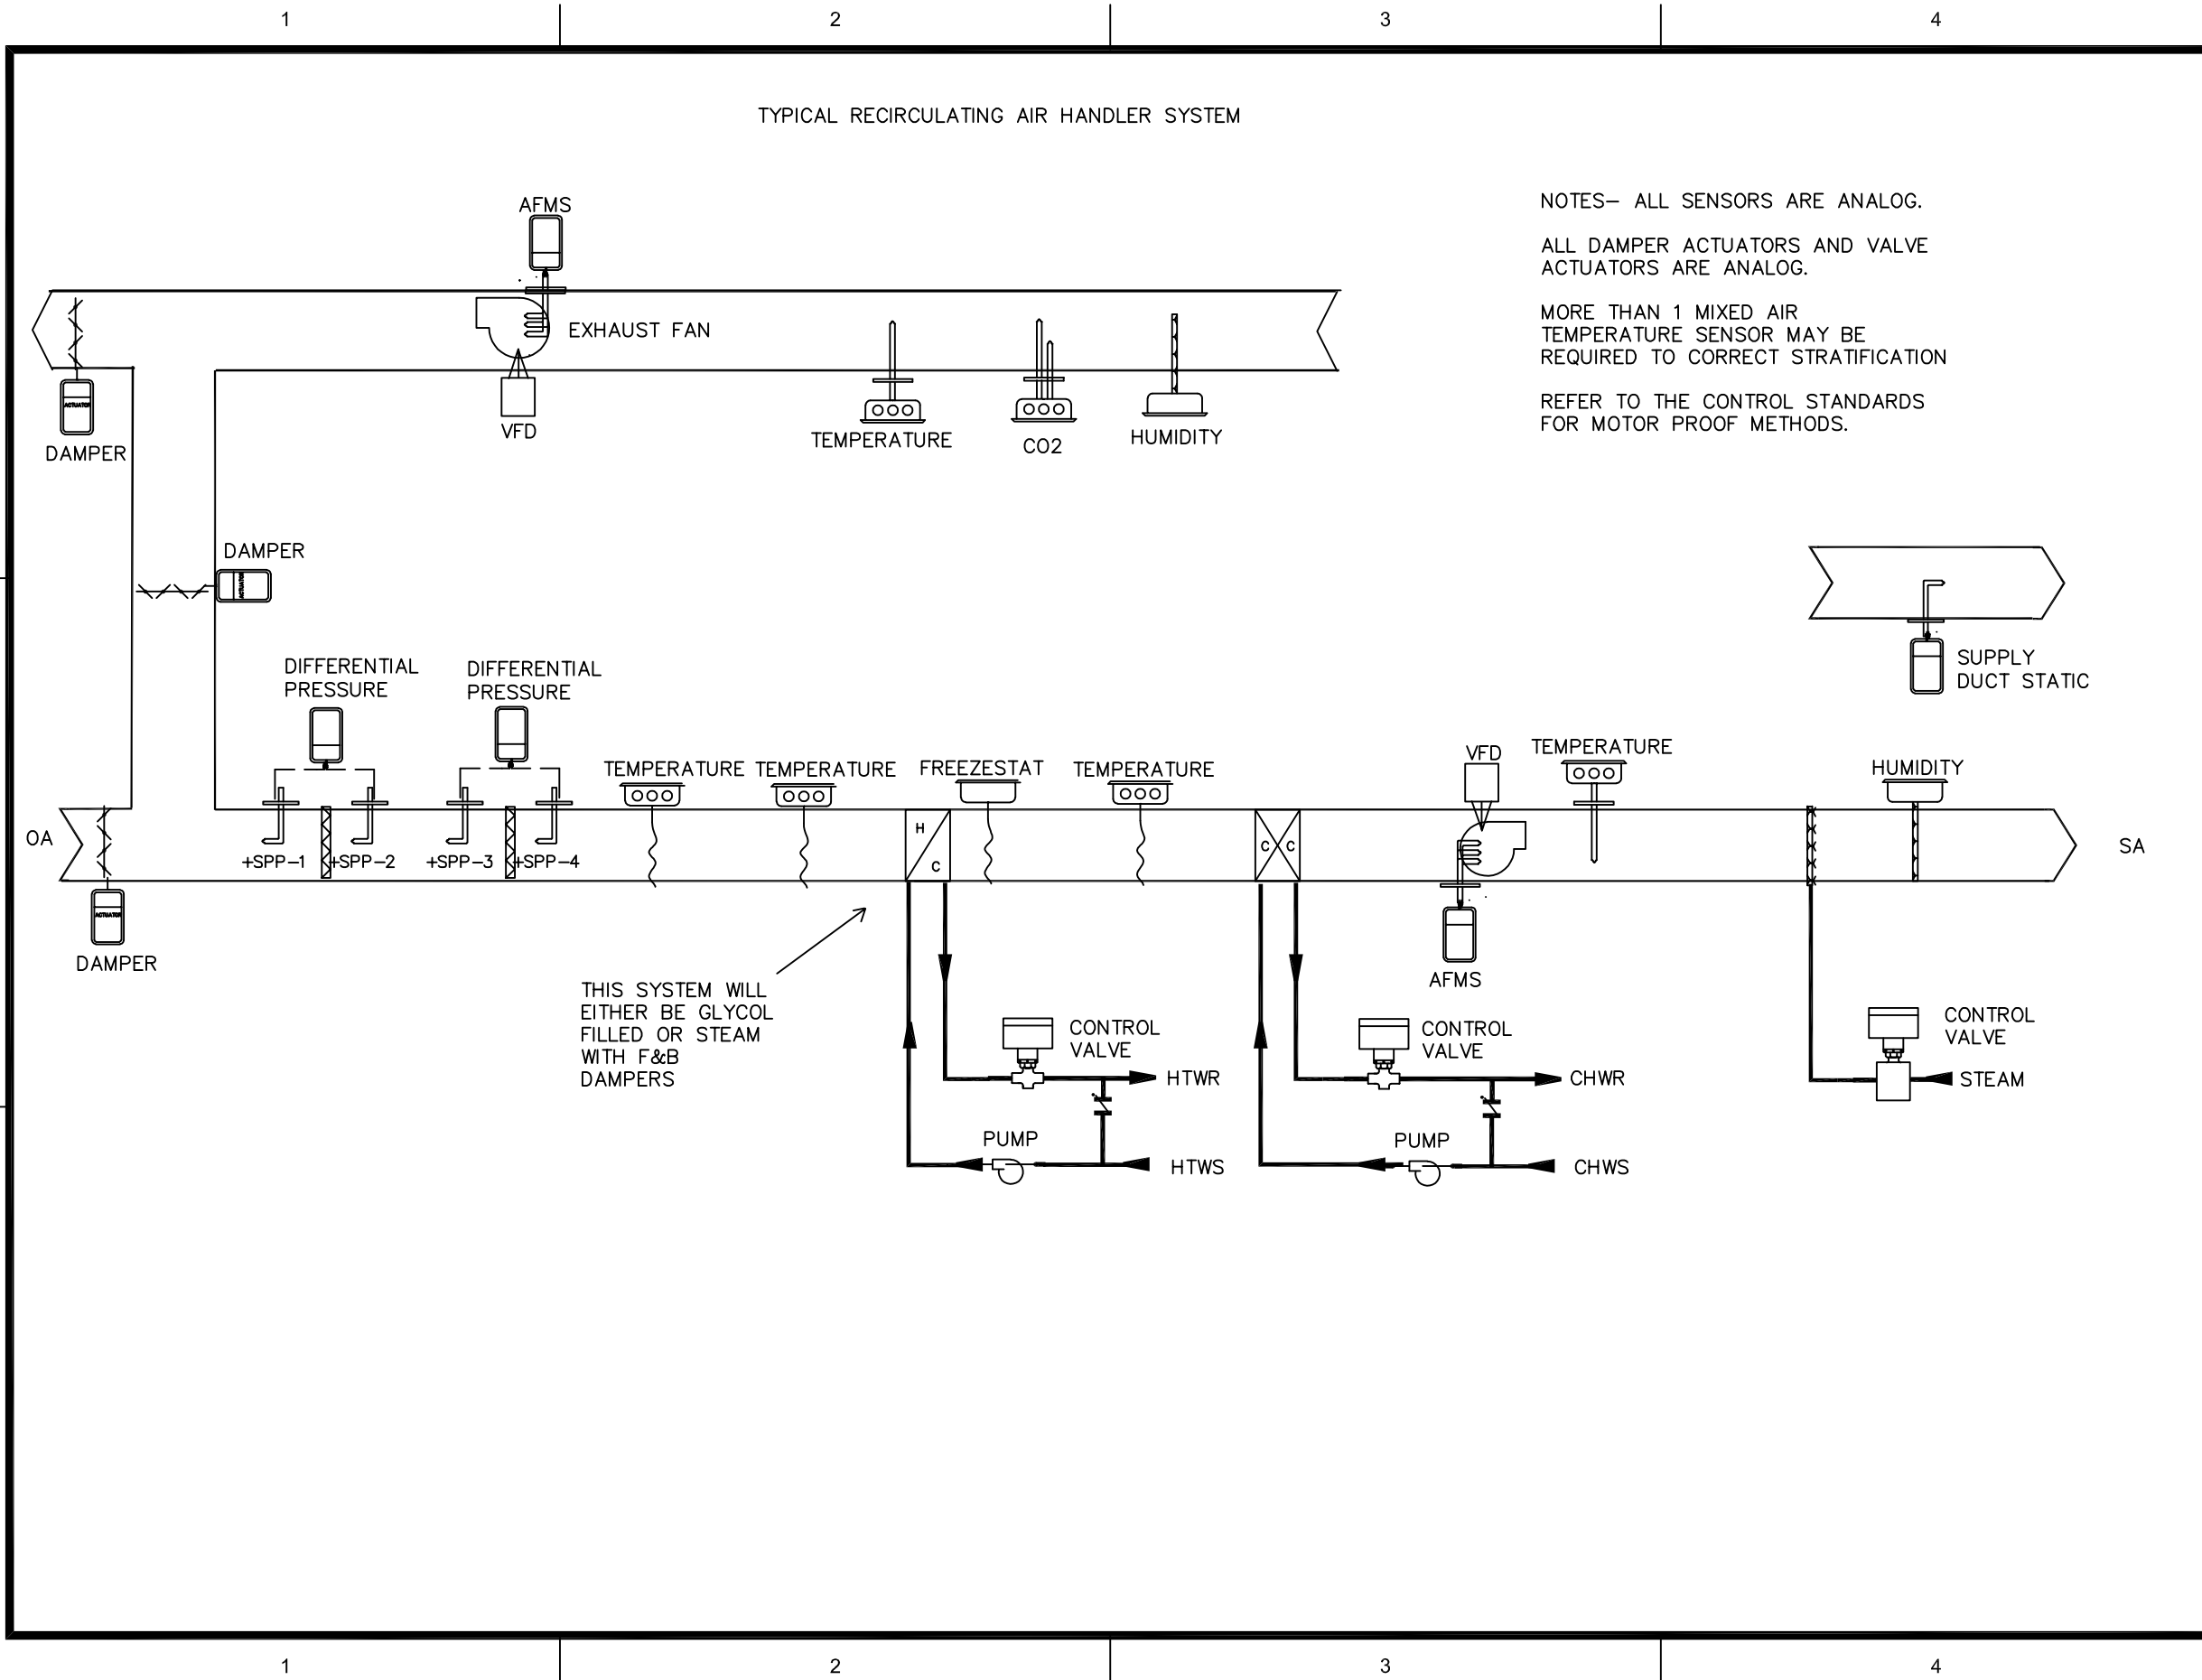

TYPICAL RECIRCULATING AIR HANDLER SYSTEM

NOTES- ALL SENSORS ARE ANALOG.
 ALL DAMPER ACTUATORS AND VALVE ACTUATORS ARE ANALOG.
 MORE THAN 1 MIXED AIR TEMPERATURE SENSOR MAY BE REQUIRED TO CORRECT STRATIFICATION
 REFER TO THE CONTROL STANDARDS FOR MOTOR PROOF METHODS.

THIS SYSTEM WILL EITHER BE GLYCOL FILLED OR STEAM WITH F&B DAMPERS

DESIGN FIRM:

WASHINGTON STATE UNIVERSITY
 Facilities Services
 225 SE Idaho Street
 Pullman, Wa. 99164-3611
 PH: 509-335-5571
 FAX: 509-335-6879

CAD DWG FILE:	
DESIGN BY:	
DRAWN BY:	CHECKED BY:
PROJECT No.:	FILE No.:
COPYRIGHT: WASHINGTON STATE UNIVERSITY	

SHEET TITLE